



Government of Karnataka

**Office of the District Fire Officer, Karnataka State Fire and Emergency Services,
Mysuru District, Saraswathipuram, Mysuru-09.**



Tel : 0821-2493101

Email : dfomyuru.ksfes[at]ka.gov.in

Mob : 9480823660

No: School/CC-76/DFO/MY/2022-23

Date : - 04-09-2025.

To,
The Managing Trustee
Esha M.V.Govindaraja Setty Trust®
225/1, Small Bazar Street,
T.Narasipura-571124.

Sub : Issued the 'Fire Safety Compliance certificate' to existing educational building of "Esha Tattva School " at Katha No. 324/309, Chowhalli Village, Muguru Hobli, T.Narasipura Tq, Mysuru Dist.,

Ref : 1. No.School/RFSR-76/DFO/MY/2022-23, dated: 21-08-2025
2. Your request letter, dated: 25-08-2025.
3. No. GBC (2)044/2020-21 dated: 21-06-2022.

><><*<><><

With reference to the subject above cited, 'Fire Safety Recommendation' was issued wide reference (1) to the premises of "Esha Tattva School" at Katha No. 324/309, Chowhalli Village, Muguru Hobli, T.Narasipura Tq, Mysuru Dist., with a condition to fulfill the recommendations and compliance the same within 3 months.


With reference cited (2) above, the management of "Esha Tattva School" had requested for the renewal of fire safety compliance certificate from our department. In this regard as per reference (3) inspected by me on 04-09-2025 & found that the school management has been fulfilled the fire fighting systems and the fire fighting systems are in good working condition during my inspection.

Under the above circumstances the Karnataka Fire & Emergency Services Department is issued the 'Fire Safety Compliance Certificate' to "Esha Tattva School" at Katha No. 324/309, Chowhalli Village, Muguru Hobli, T.Narasipura Tq, Mysuru Dist., subject to proper maintenance of fire fighting installations in good working conditions and to the fire safety compliance certificate valid up to 20-08-2026 (Twentieth August Two thousand twenty six) and is renewable.

Udise Code-29264100072



Copy with compliments: Submitted to the
Director General of Police and Director General,
Karnataka State Fire and Emergency Services, Bengaluru-42.

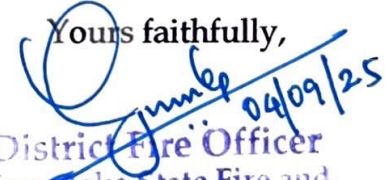Yours faithfully,

District Fire Officer
Karnataka State Fire and
Emergency Services
Mysuru District, Mysuru



Government of Karnataka



Office of the District Fire Officer, Karnataka State Fire and Emergency Services,
Mysuru District, Saraswathipuram, Mysuru-09.

Tel : 0821-2493101

Email : dfomyuru.ksfes[at]ka.gov.in

Mob : 9480823660

No: School/Rev-FSR-76/DFO/MY/2022-23

Date: - 21-08-2025.

To,

The Managing Trustee
Esha Tattva School
Katha No.324/309, Chowhalli,
Muguru hobli, T.Narasipura-571124.

Sub : Issue d the 'Revised-Fire safety recommendation' to existing educational building of "Esha Tattva School " at Katha No. 324/309, Chowhalli Village, Muguru Hobli, T.Narasipura Tq, Mysuru Dist.,

Ref : 1. Your request letter, dated: 05-08-2025.
2. No. GBC (2)044/2020-21 dated: 21-06-2022.

><><*<><><

With reference to the subject above cited, the premises of existing educational building of "Esha Tattva School" at Katha No. 324/309, Chowhalli, Muguru Hobli, T.Narasipura Tq, Mysuru Dist., was inspected by me on 05-08-2025 with respect to Fire prevention, Fire fighting and Evacuation measures to be complied in the above premises and has submitted the details as under.

ANNEXURE-I

"Group B Educational Buildings"

NBC-2016, Part-4, Table 7(11) 3.1.3 Group B Educational Buildings sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

Part-A. Details of the building / premises:-

01.	Name and Address of the Applicant.	:	The Trustee M/s Esha Tattva School At Katha No. 324/309, Chowhalli, Muguru Hobli, T.Narasipura Tq, Mysuru Dist.,
02.	Name and Address of the premises.	:	M/s Esha Tattva School At Katha No. 324/309, Chowhalli, Muguru Hobli, T.Narasipura Tq, Mysuru Dist.,
03.	Name and address of the Building owner	:	Smt. Padma Manjunath W/o Manjunatha Shetty Market Street, Ward No.04, T.Narasipura, Mysuru District.
04.	Number of buildings	:	01 School building.
05.	Number of floors	:	Ground floor + 1 Upper floor.
06.	<u>Floor-wise details of occupancy:-</u>		




	Ground floor	:	Lobby, Reception, Cash counter, Treasurer, School office, Record room, IT Centre, 02 Pantry rooms, Board room, Chairman room, Principal room, Maintenance room, Sick room, 07 Class rooms, Staff room, 04 wash rooms, Store room & Toy room.
	1 st floor	:	11 Class rooms, Staff room & 03 Wash rooms.
07.	Height of the building	:	08.40 Mtrs.
08.	Site area	:	10,159.778 Sq.mtrs.
09.	Built-up area of each floor:-	:	Ground floor:-1,565.93 Sq.mtrs. 1 st floor:-1,531.22 Sq.mtrs.
10.	Total built-up area	:	3,097.15 Sq. Mtrs.
11.	Surrounding properties:-		
	West	:	10.20 mtrs. Wide road.
	East	:	Private property.
	North	:	Private property.
	South	:	Private layout.
12.	Open space all around the building :-		
	West (Front)	:	04.26 mtrs.
	East (Rear)	:	04.26 mtrs.
	North (Side)	:	04.26 mtrs.
	South (Side)	:	04.26 mtrs.
	Allowed setback (open space) should be maintained free from further obstruction / construction.		

Part-B. On inspection of this School/College premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

essential from fire safety point of view :-


Sl. No. (1)	Details (02)	Existing (03)		Recommendations (04)
01.	Accessibility to the premises	This premise is abutting 10.20 mtrs. width national highway road towards western side.		Adequate.
02.	No. of entrances	01 entrance cum exit of 06.00 mtrs. width has been provided.		Adequate.
03.	No. of staircases available	Nos. of staircases	02 nos.	Complied.
		Width of staircases	01.80 Mtrs.	
		Width of treads	30 CM	
		Height of risers	15 CM	
		Nos. of riser per flight	11 No's	

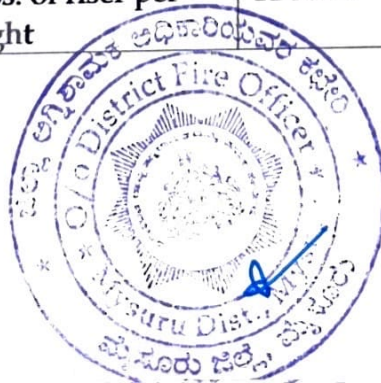

		Height of handrails	00.90 Mtrs.	
		Head room clearance	03.20 Mtrs.	
04.	No. lifts and capacity.	Nos. of lifts	Nil	--
		Capacity of lifts	-	
05.	Diesel generators.	One diesel generator of 15 KVA capacities has been provided to supply alternative power supply.		Complied.
06.	Portable Fire Extinguisher.	A. One water mist extinguishers of 9 ltrs capacity has been provided near each staircase landing. B. One mechanical foam extinguishers of 9 ltrs capacity & one ABC type extinguishers of 6 kgs capacity have been provided near diesel generator. C. One CO2 type fire extinguisher, of 4.5 kgs capacity has been provided near each electrical panel board & electrical room.		D. One ABC type fire extinguisher of 6 kgs capacity should be located as to be available within 15 mtrs. radius. All the extinguishers suggested above should be with BIS markings and should be located at an easily accessible position without obstructing the normal passage and maintained periodically.
07.	First aid Hose reel hose.	01 no. Of Hose Reel Hose near the staircase. The hose reel hose of min 19 mm size and 100 mm internal diameter made up of G.I 'C' class pipe and of adequate length to reach the farthest point of each floor and shut off branch having a nozzle of 5mm size.		Another hose reel hose system should be connected to an over head tank of 5,000 liters capacity and further if basement/stilt/cellar is provided the tank capacity shall be increased to 10,000 liters capacity. (The water tank should be kept exclusively fire fighting purpose) Note: If the existing building is not capable of sustaining the weight of 5,000/10,000 ltrs. Tank capacity provision shall be made to provide water tank on the side of the



			building with support from ground level by providing RCC column structure of MS column structure. If there is no option to provide even the above mentioned overhead tank provision shall be made to provide underground water tank of capacity with submersible pump of 5-7 HP capacity.
08.	Terrace tank over respective tower terrace.	An over head tank of 5,000 liters capacity.	Hose reel hose system should be connected to another over head tank of 5,000 liters capacity and further if basement is provided the tank capacity shall be increased to 10,000 liters capacity. (The water tank should be kept exclusively fire fighting purpose) Note: If the existing building is not capable of sustaining the weight of 5,000/10,000 ltrs. Tank capacity provision shall be made to provide water tank on the side of the building with support from ground level by providing RCC column structure of MS column structure. If there is no option to provide even the above mentioned overhead tank provision shall be made to provide underground water tank of capacity with submersible pump of 5-7 HP capacity.
09.	At the terrace tank	Hose reel hose systems have	Another hose reel hose

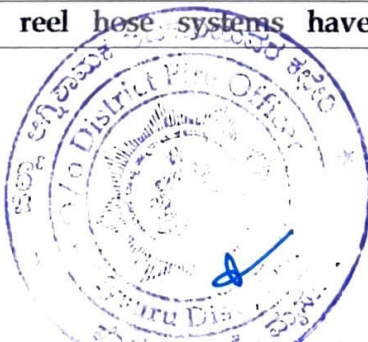

	level with minimum pressure of 3.5 kg/cm ² .	been connected to a booster pump of 450 LPM or of 5 HP capacities.	system should be connected to another booster pump of 450 LPM or of 5 HP capacities. (Further the system should be connected to an alternative source of power supply)
10.	Escape routes.	Directions in which the inmate's should have to move in the event of any emergency have to be indicated in the corridor/passage as a guide during evacuation. These marking have been in luminous paint.	Complied.
11.	Fire order. (Fire Safety plans)	A notice board indicating the action to be taken by the employees in case of any emergency have been displayed along with the telephone number of T.Narasipura Fire Station 08227-260101 & 101 and the telephone number of nearest ambulance service & Police station.	Complied.
12.	No Smoking board.	As per Sec-4 of COPTA a board with words NO SMOKING AREA shall be written in English & Kannada both languages has been prominently displayed at inside the entry / exit of the each floor.	Complied.
13.	Training in Fire fighting .	Not imparted.	At-least 40% of Teaching and non teaching staff should be got trained in fire fighting at R.A Mundkur Fire & Emergency Services Academy, Bannerghatta Road, Bangalore or Regional Training Center or District Fire officer , Mysuru District,



			Mysuru.
14.	Fire Siren.	A Fire Siren has been installed in the Premises to inform the inmates in case of a fire emergency and evacuate the area.	Complied.
15.	Nominate one Fire Nodal Officer.	Sri. Vinod Kumar P.V., as nominated the Fire nodal officer to this school.	Complied.

Fire precautionary measures.

- Explosive and flammable material should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises.
 - Accumulation of combustible waste in and around the premises should be avoided.
 - The exit ways shall be always kept clear without any obstruction.
 - Liquefied petroleum gas should not be stored in the building except in the Kitchen (Provided for Mid-Day Meal Preparation)
 - The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
 - During the class hours the class room doors shall not be locked from inside to outside.
- As per Hon'ble supreme court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department.

Under the above circumstance the Karnataka Fire & Emergency Service Department is issuing 'Revised-Fire Safety Recommendation' to "Esha Tattva School" at Katha No. 324/309, Chowhalli, Muguru Hobli, T.Narasipura Tq, Mysuru Dist., subject to condition and compliance of the above recommendations in within 3 months and compliance to the undersigned.


"This Revised-Fire Safety Recommendation is valid for only one year from the date of issue and it is renewable".

♣ All requirements recommended above are as per National Building code-2016 Part-4 Clause 3.1.3 of Fire and Life safety will have to be complied with mandatorily.

Yours faithfully,

[Signature]
District Fire Officer
Karnataka State Fire and
Emergency Services
Mysuru District, Mysuru

Copy with compliments: Submitted to the
Director General of Police and Director General,
Karnataka State Fire and Emergency Services, Bengaluru-42.

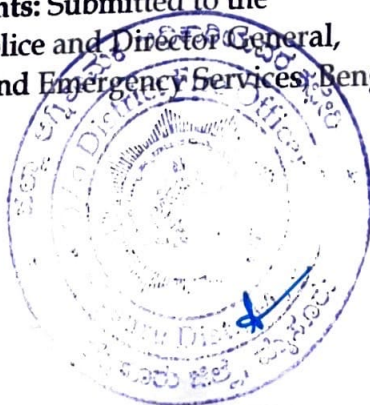



ESHA TATTVA SCHOOL

#324/309, T. Narasipura – Kollegala Main Road,
T. Narasipura Taluk, Mysuru Dist – 571124. Call : 6366099007

ರವರಿಗೆ

ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿ,
ಅಗ್ನಿ ಶಾಮಕ ದಳ, ಸರಸ್ವತಿಪುರಂ.
ಮೈಸೂರು 570009

ಮಾನ್ಯರೇ,

ವಿಷಯ : ತಿ. ನರಸೀಪುರ ತಾಲ್ಲೂಕು, ಮೂಗೂರು ಹೋಬಳಿ, ನಿಲಸೋಗೆ ಗ್ರಾಮ, ಖಾತಾ ಸಂಖ್ಯೆ 324/309, ತಿ. ನರಸೀಪುರ – ಕೋಲೇಗಾಲ ಮುಖ್ಯ ರಸ್ತೆ ಬಳಿ ಇರುವ ಈಶ ಎಂ ವಿ ಗೋವಿಂದರಾಜಶೆಟ್ಟಿ ಟ್ರಸ್ಟ್ (ರಿ). ಗೆ ಸೇರಿದ ಈಶ ತತ್ವ ಶಾಲೆ, ಶಾಲಾ ಕಟ್ಟಡದ ಅಗ್ನಿ ಮತ್ತು ಸುರಕ್ಷತಾ ಪ್ರಮಾಣ ಪತ್ರವನ್ನು ನವೀಕರಿಸುವ ಬಗ್ಗೆ.

REF: 1. Report No. 48(9)/School/RCC/FSO/TNP/2022, date: 12-12-2022.

2. No.66(76)/School/Rev-FSR/DFO/MY/2022-23, date: 05/07/2024

ಮೇಲಿನ ವಿಷಯಕ್ಕೆ ಸಂಬಂಧಿಸಿದಂತೆ ಈಶ ಎಂ ವಿ ಗೋವಿಂದರಾಜಶೆಟ್ಟಿ ಟ್ರಸ್ಟ್ (ರಿ). ಗೆ ಸೇರಿದ ಈಶ ತತ್ವ ಶಾಲೆ, ಶಾಲಾ ಕಟ್ಟಡದ ಸುರಕ್ಷತಾ ಮತ್ತು ಮೂಲಭೂತ ಸೌಕರ್ಯಗಳನ್ನು ಕುರಿತಂತೆ ಸೂಕ್ತ ವರದಿಗಳನ್ನು ಪರಿಶೀಲಿಸಿ ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಕಚೇರಿ, ಇವರು 2022-23 ಮತ್ತು 2024-25ನೇ ಸಾಲಿಗೆ ಶಾಲಾ ಕಟ್ಟಡದ ಅಗ್ನಿ ಮತ್ತು ಸುರಕ್ಷತಾ ಪ್ರಮಾಣ ಪತ್ರವನ್ನು ನೀಡಿದ್ದು, ಸದರಿ ಪ್ರಮಾಣ ಪತ್ರವನ್ನು 2025-26ನೇ ಶೈಕ್ಷಣಿಕ ಸಾಲಿಗೆ ನವೀಕರಿಸಿಕೊಡಬೇಕೆಂದು ಕೋರಿ ಸೂಕ್ತ ದಾಖಲೆಗಳೊಂದಿಗೆ ಕಟ್ಟಡದ ನವೀಕರಣ ಪತ್ರವನ್ನು ಈ ಪತ್ರದ ಮೂಲಕ ತಮ್ಮ ಅವಗಾಹನೆಗೆ ಸಲ್ಲಿಸುತ್ತಿದ್ದೇವೆ.

ವಂದನೆಗಳೊಂದಿಗೆ,

ತಮ್ಮ ವಿಶ್ವಾಸಿ

M. Shreeya
16/07/2025

